




InVENTive TECHNOLOGY®

# Specification Sheet / Tec-Vent™

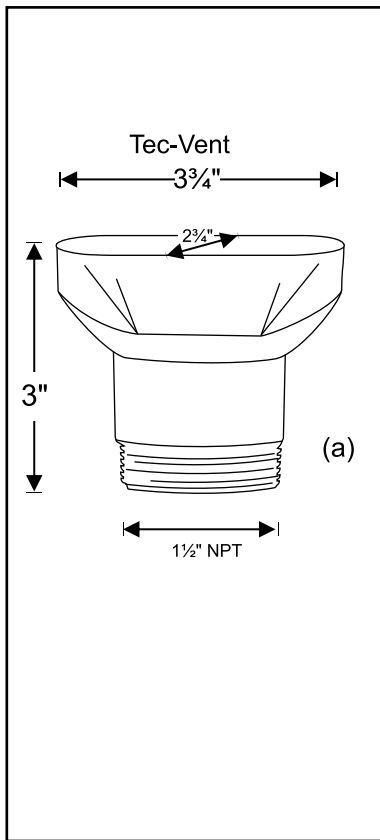

**Manufacturer: Studor, Inc.**  
**Item #: 20344**

**Model: Tec-Vent™**  
**Connection Size: 1 1/2"**

**General:**

An air admittance valve shall be acceptable as a vent termination for any individual vent, common vent, circuit vent, loop vent and island fixture vent that is provided to prevent siphonage of a fixture trap. An air admittance valve can be used as an alternative to extending a vent through the roof (or sidewall) to the open atmosphere.

**Location:**

- A. The Tec-Vent should be located a minimum of 4" above the weir of the fixture trap for single fixture and branch venting.
- B. Each valve should be installed in an accessible location.

**Installation:**

- A. The valve should be connected to the piping in accordance with the manufacturer's installation instructions.
- B. The valve should be installed in the vertical, upright position after rough-in and pressure testing of the DWV system.
- C. A minimum of one vent shall extend to the open atmosphere for every building drainage system.
- D. The valve should not be installed as a vent terminal for any special(chemical) waste system.
- E. The valve may be installed on sewer ejectors, if installed according to engineer design and prior local code approval.
- F. For installation in areas with temperature range between -40° F and 150° F.
- G. The valve may be installed in supply and return air plenums if installed according to engineer design and prior local code approval.
- H. Not for installation in non-neutralized chemical waste systems.

**Materials:**

(A) Flame-retardant polycarbonate resin valve with elastomeric membrane.

**Features:**

- A. Screening on the inside and outside of the valve to protect the sealing membrane from insects and debris.
- B. Ability to divert condensation away from the sealing membrane.
- C. UV Rated
- D. Limited lifetime warranty for replacement of defective valves.

**Performance Standards:**

- ANSI/ASSE 1051 (revised 2002) single fixture and Branch type AAVs
- NSF Standard 14 (Plastic Components)
- Classified in accordance with UL 2043 for installation in plenums.

**Code Approvals:**

- International Plumbing Code (IPC) 2003 Edition
- Southern Building Code Council International (SBCCI) 1994 Edition
- Building Official Code Administration (BOCA) 1993 Edition
- International Residential Code (IRC) 2003 Edition
- Uniform Plumbing Code (UPC) Section 301.2 Alternative Materials and Methods 2003 Edition

**Listings:**

- ASSE Seal of Approval
- National Evaluation Services (NER-592)
- NSF International (NSF Standard 14)
- NSF International (ANSI/ASSE Performance Standard 1051)
- IAMPO Classified Marking, file No. C-3803
- Warnock Hersey (ITS - Intertek Testing Services)

### Sizing Chart

| Horizontal Branch Size | Max DFUs |
|------------------------|----------|
| 1 1/2"                 | 3        |
| 2"                     | 6        |
| 3"                     | 20       |
| 4"                     | 160      |

